



ADDENDUM #1
North Shore Channel Shoreline Stabilization Bid

Issued May 7, 2026


This addendum must be included with your sealed bid.

This addendum is hereby incorporated into the bid documents of the project referenced above. A potential bidder asked the below question. The following item serves as clarification and addition to the bid documents.

Question: Could you supply a detail for the concrete ribbon curb?

Response: A detail drawing has been provided in conjunction with the Permeable Paver Detail on page C-8.0 of the plan set. Please replace original plan Sheet C-8.0 with Sheet C-8.0 with the Addendum 1 date of 05-07-2026.


STRUCTURAL STREAMBANK STABILIZATION – GABIONS

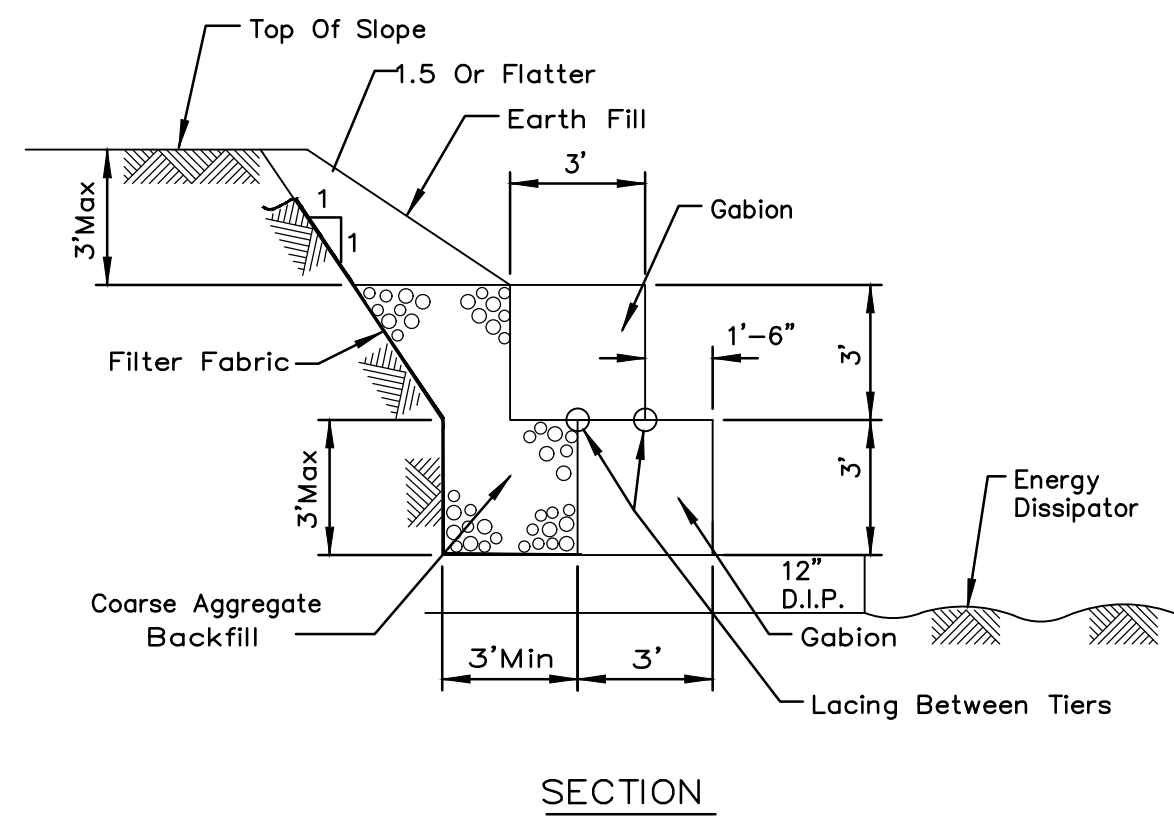

- NOTES:
1. The filter fabric shall meet the requirements in material specification 592 GEOTEXTILE Table 1 or 2, Class I, II or III.
 2. The coarse aggregate backfill shall meet the IDOT requirement for the following gradations CA-1, CA-3 or RR-1.
 3. The Gabions shall be installed according to construction specification 64 WIRE MESH GABIONS.
 4. Baskets which are stacked in tiers shall have vertical seams staggered for each row and tier.
 5. The coarse aggregate backfill shall be placed level with the top of the lower basket before the upper basket is installed.


REFERENCE Project _____	STANDARD DWG. NO. IL-641
Designed _____ Date _____	SHEET 1 OF 1
Checked _____ Date _____	DATE 5-16-94
Approved _____ Date _____	

STRUCTURAL STREAMBANK STABILIZATION – GABIONS


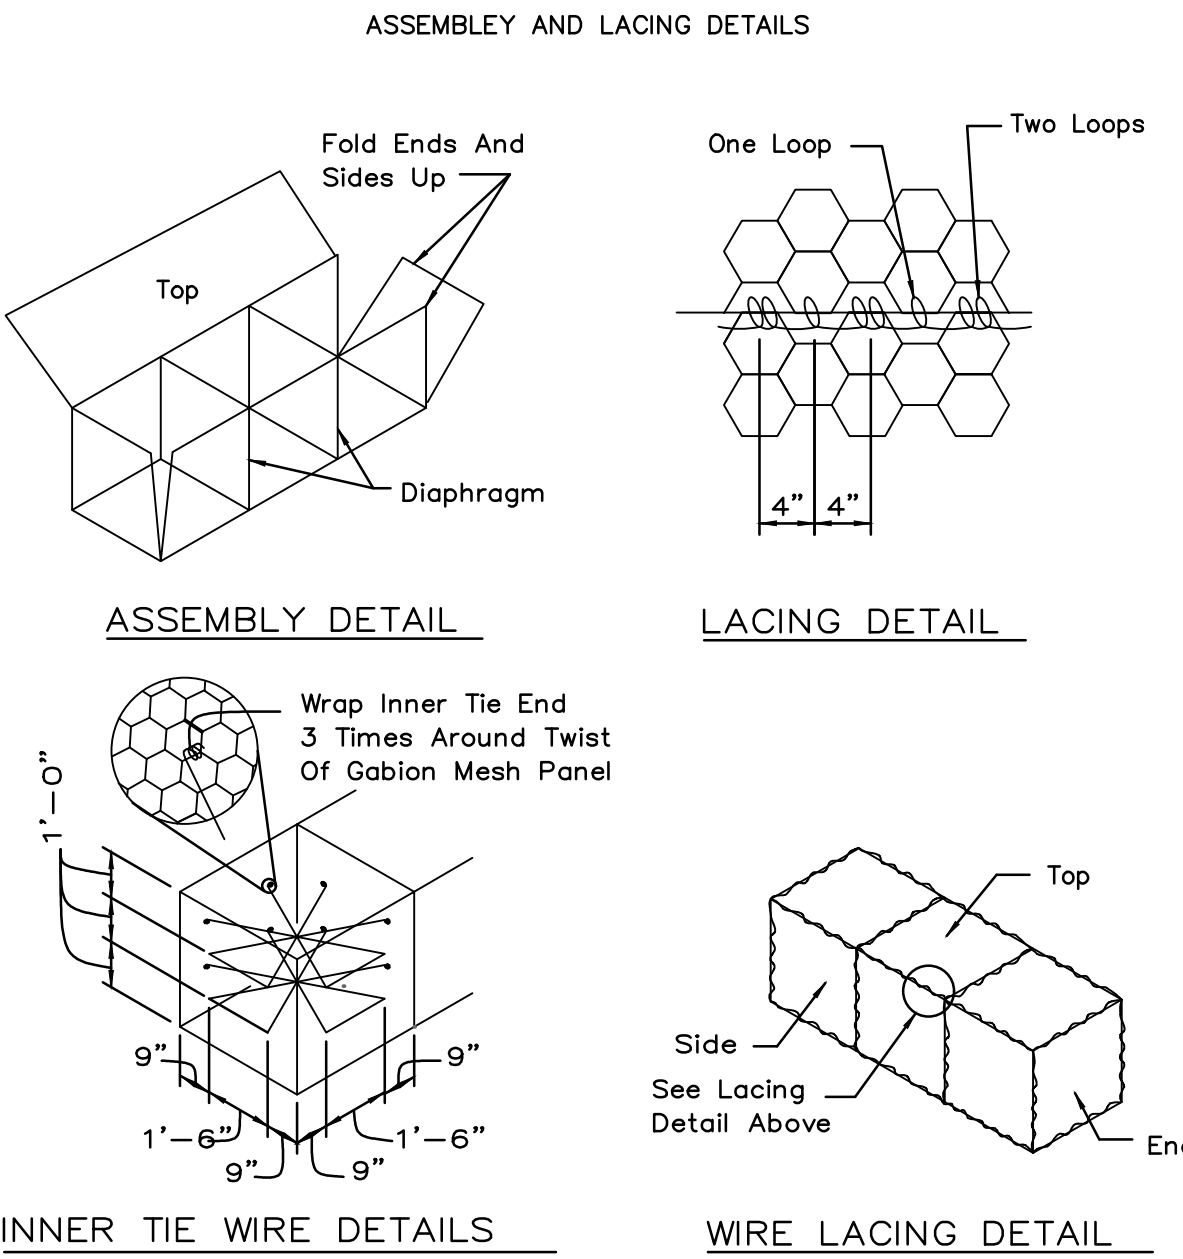


- NOTES
1. The ends of a lacing wire will be secured by looping it thru the mesh and twisting. Proceed to lace with alternate two loops and one loop at approximately 4 inch intervals.
 2. Other lacing methods may be used if recommended by the manufacturer and approved by the engineer/inspector.
 3. The "X" shaped inner tie may be twisted at the "X" to tighten, if placed too loosely.


REFERENCE Project _____	STANDARD DWG. NO. IL-645
Designed _____ Date _____	SHEET 1 OF 1
Checked _____ Date _____	DATE 5-18-94
Approved _____ Date _____	

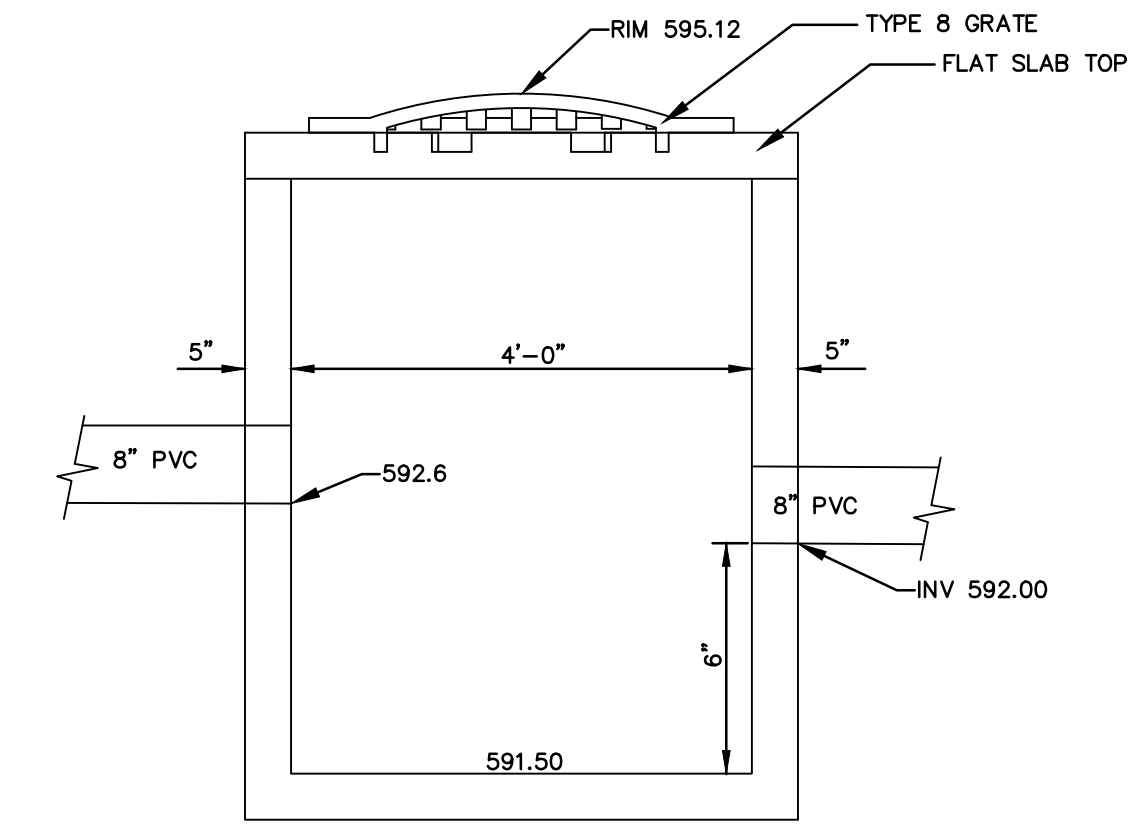

REBAR REINFORCEMENT SHALL BE IN ACCORDANCE WITH I.D.O.T. HIGHWAY STANDARD # 602401-02, MANHOLE TYPE A
SUBMIT SHOP DRAWINGS TO ENGINEER FOR APPROVAL.

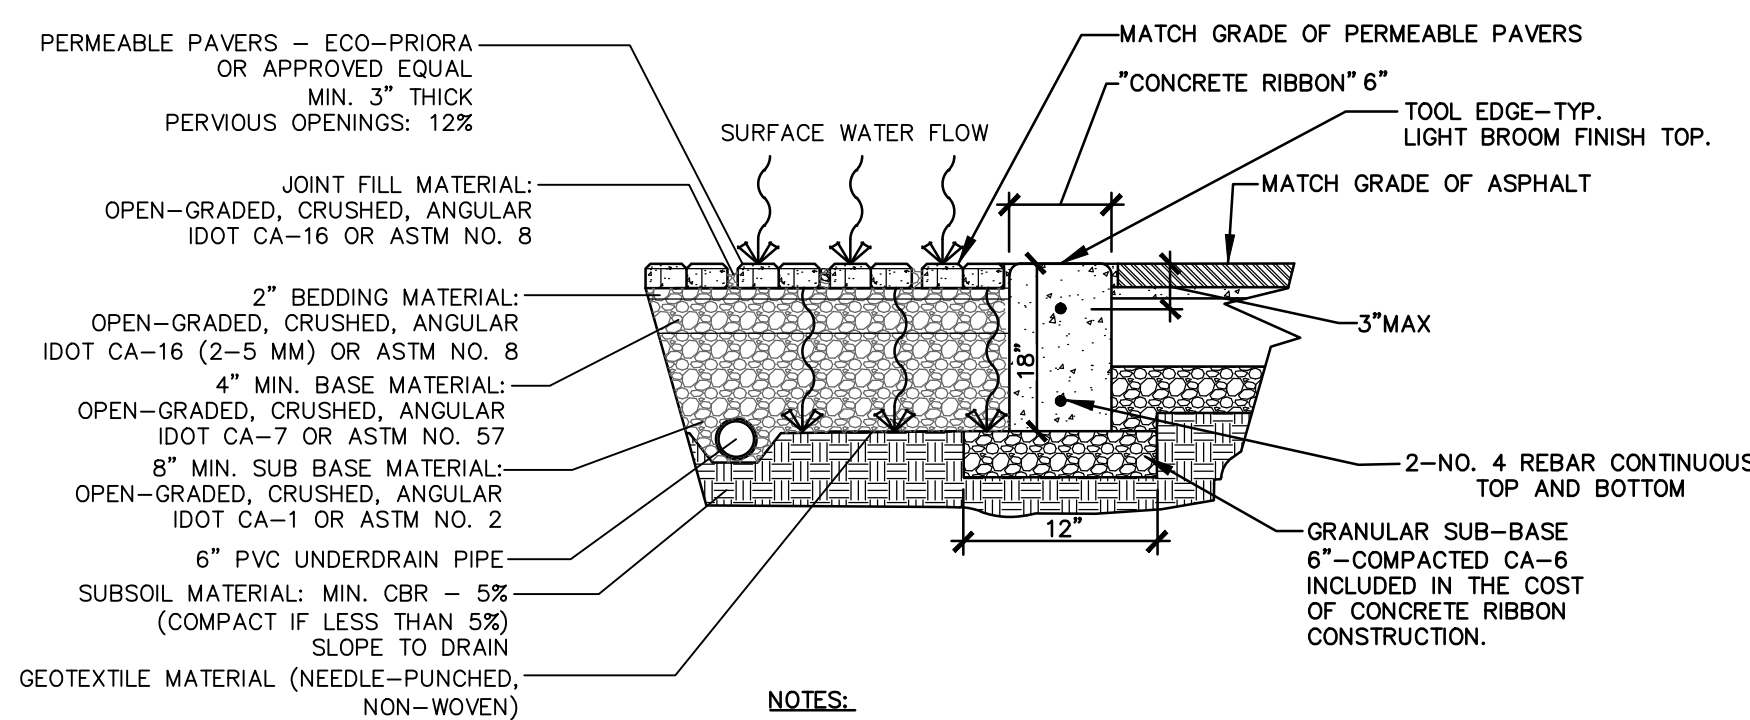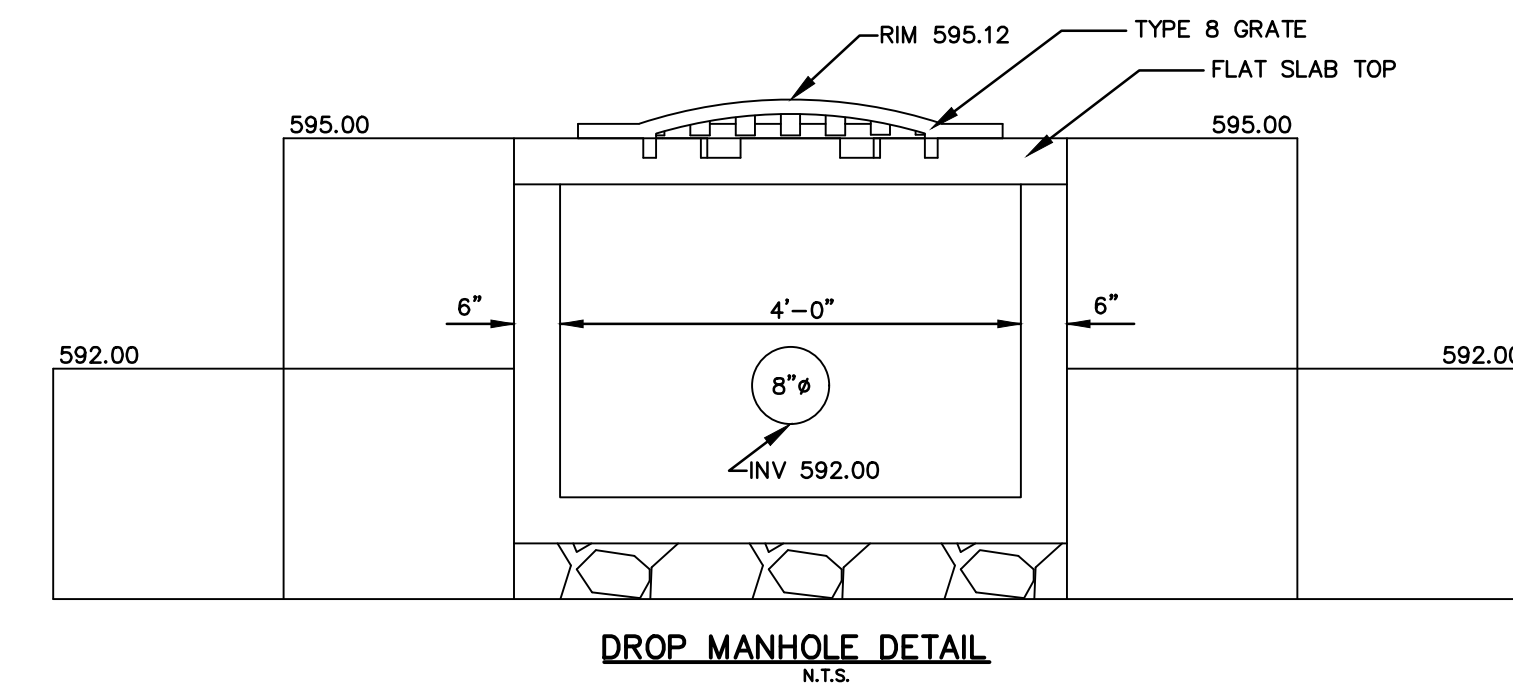

- NOTES:
1. SAW CUT CONTROL JOINTS @ 15' O.C.
 2. PREMOLDED EXPANSION JOINTS @ 50' O.C. WITH 3/4" SMOOTH SLIP DOWELS.
 3. ALL EXPOSED CONCRETE TO HAVE LIGHT BROOM FINISH.
 4. GRANULAR SUB-BASE MATERIAL INCLUDED IN THE COST OF RIBBON CONSTRUCTION.
- PERMEABLE PAVER AND CONCRETE RIBBON DETAIL**
NOT TO SCALE

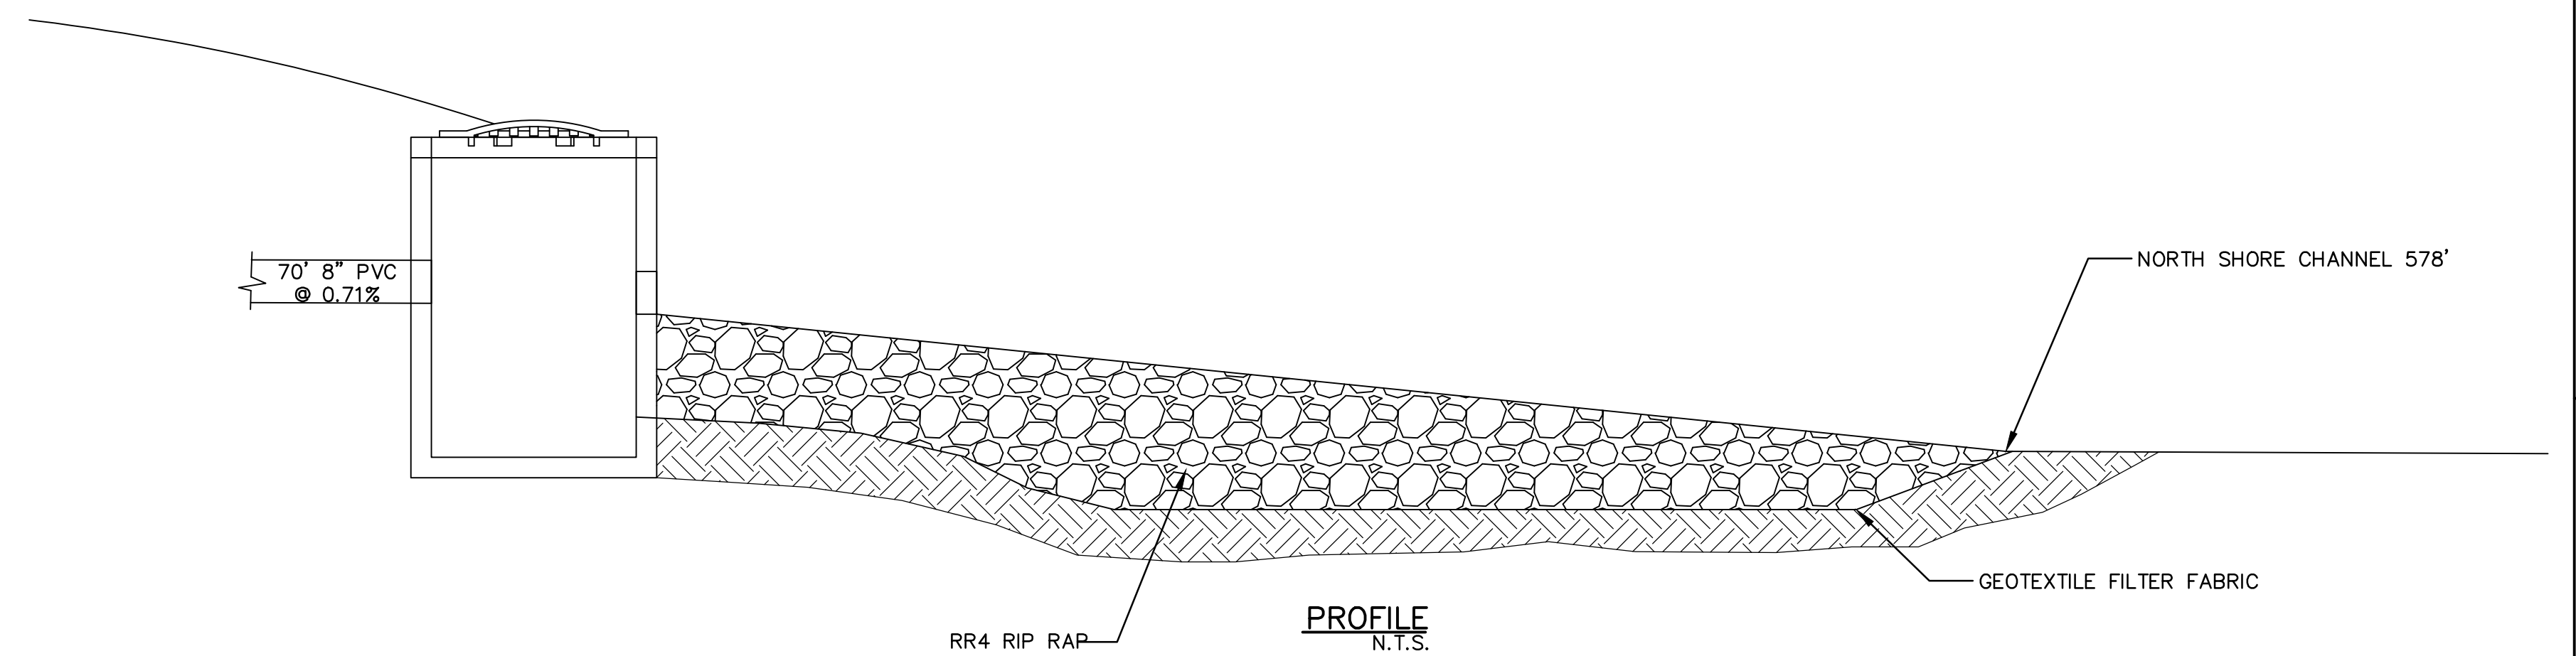

REVISION: 04-15-2026	DESCRIPTION:
ADDERDUM I: 05-07-2026	

DATE : 04-01-2026	DESIGNED BY : EP
PROJECT # : W25143.00	DRAWN BY : AEC
CHECKED BY : EP	